



EXIT SIGN MOUNTING - GYPBOARD CEILING

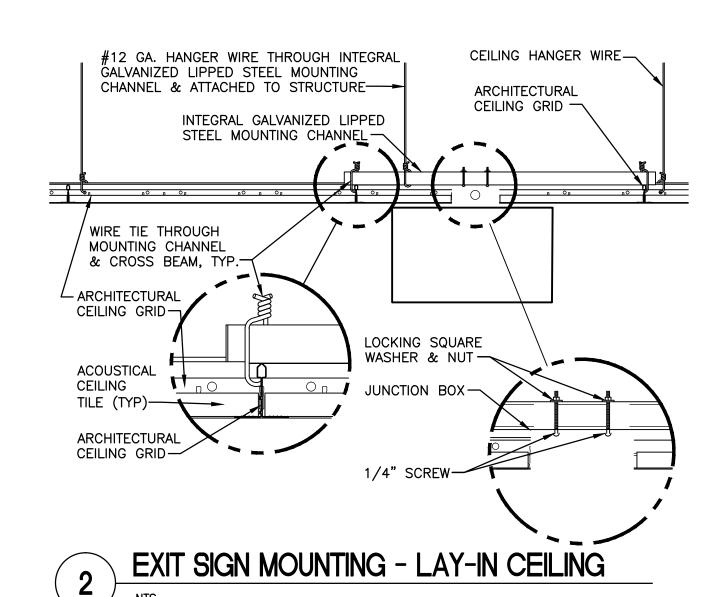

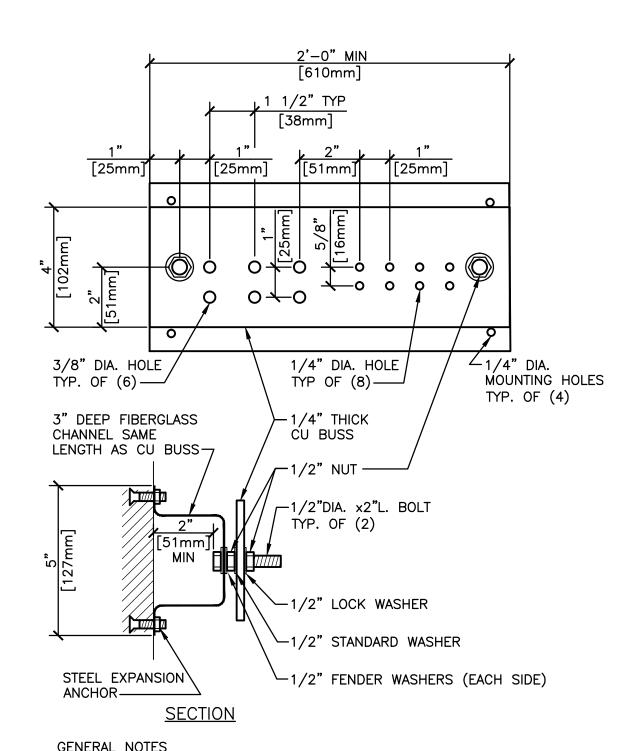


GENERAL NOTES


1. ALL HARDWARE SHOWN SHALL BE STAINLESS STEEL. 2. PROVIDE 1 MOUNTING POINT PER 12" OF BAR LENGTH.


- 3. HOLES MAY BE ADDED IF REQUIRED.



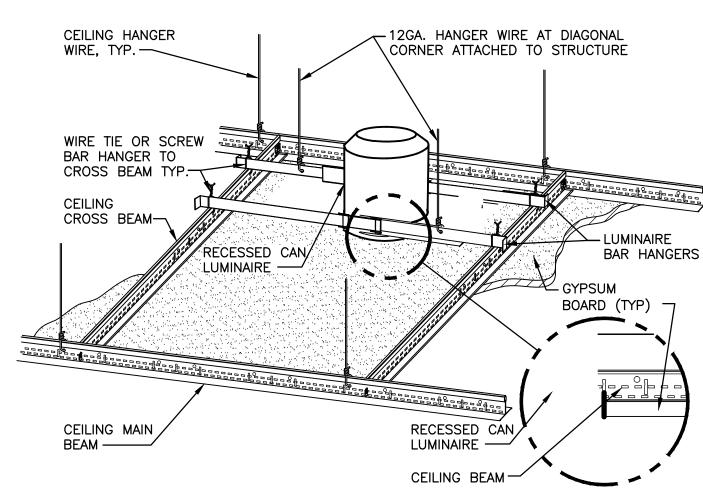


DOWNLIGHT MOUNTING - GYPBOARD CEILING

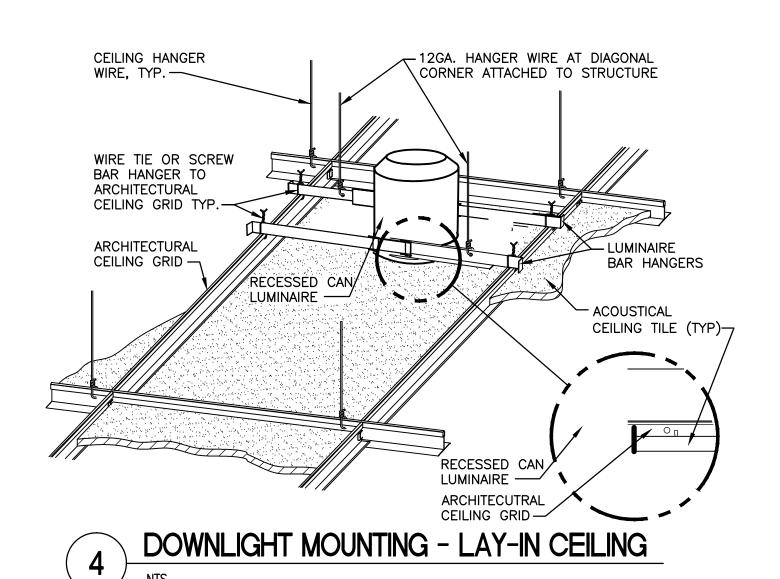


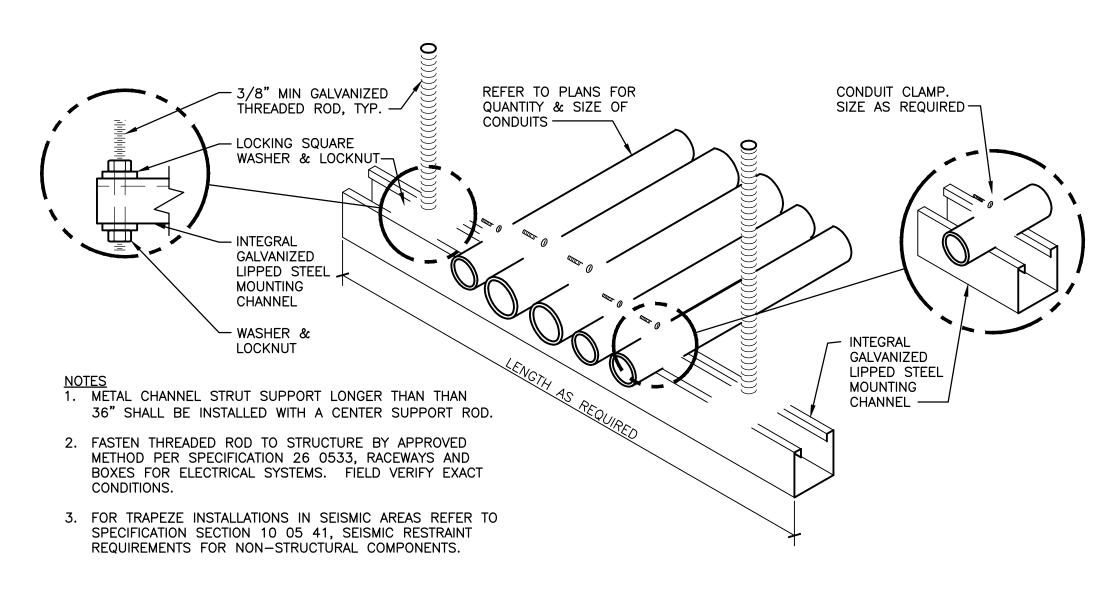


CONDUIT TRAPEZE MOUNTING DETAIL

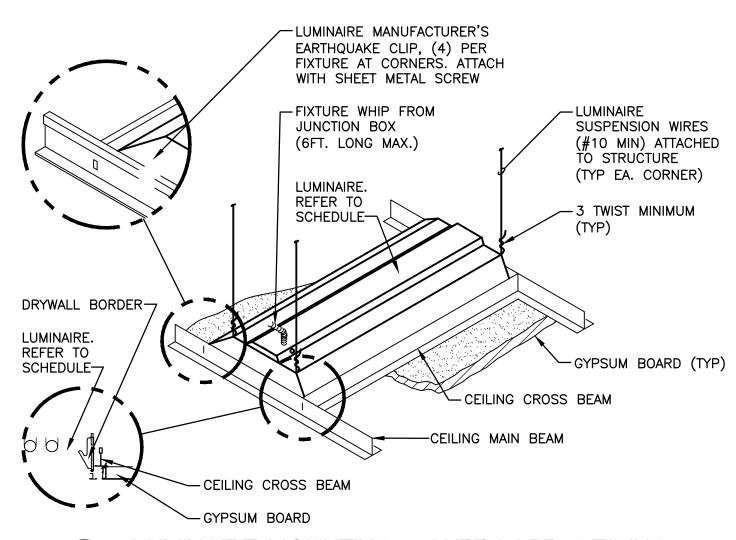

LUMINAIRE MOUNTING - GYPBOARD CEILING

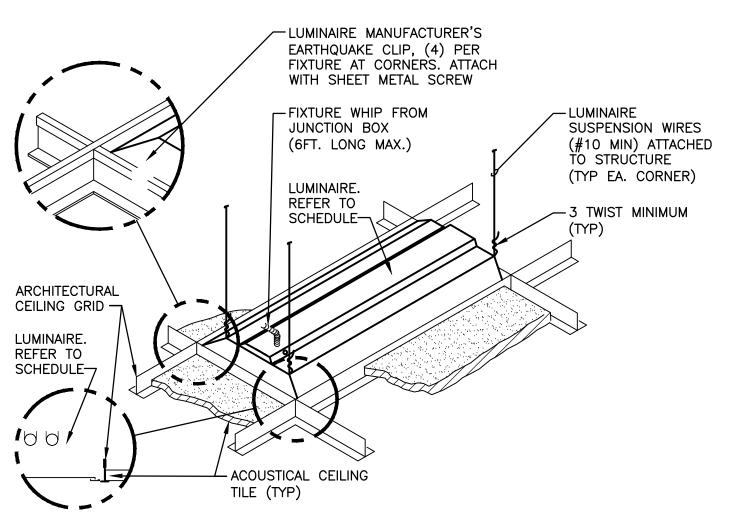

LUMINAIRE MOUNTING - LAY-IN CEILING

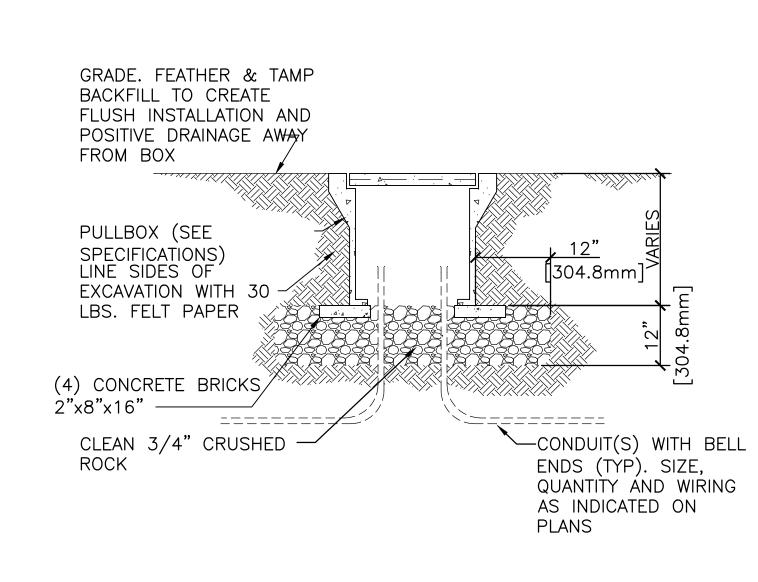



UNDERGROUND CONCRETE PULLBOX INSTALLATION IN TURF AREAS

FINAL SUBMISSION APRIL 9, 2013

IF SHEET IS LESS THAN (30"x42") IT IS A REDUCED PRINT; SCALE ACCORDINGLY DEPARTMENT OF THE NAVY

NAVAL SUPPORT ACTIVITY





NATURAL RESOURCES & ENVIRONMENTAL AFFAIRS	P.W. DWG. NO.
SATISFACTORY TO DATE	
SAFETY DEPARTMENT	DRAWN BY - GWS
SATISFACTORY TO DATE	CHECKED BY
FIRE DEPARTMENT	SUPERVISOR
SATISFACTORY TO DATE	WWB
	APPROVED DATE
PUBLIC WORKS SUPERVISOR	
SATISFACTORY TO DATE	
	DIDLIC WORKS OFFICED

PANAMA CITY, FLORIDA CONSTRUCT NAVAL BRANCH HEALTH CLINIC PANAMA CITY **ELECTRICAL DETAILS**

SIZE | CODE IDENT. NO. HOMC PROJ. NO. 520-13-200 CONSTR. CONTR. NO. MACC. T.O.# ____ SHEET 8 OF 13 SCALE **NONE** PUBLIC WORKS OFFICER